


## MODIFICATION DIAGRAM

## THREE LEM-1DL MASTER STATIONS WITH ONE SUB STATION

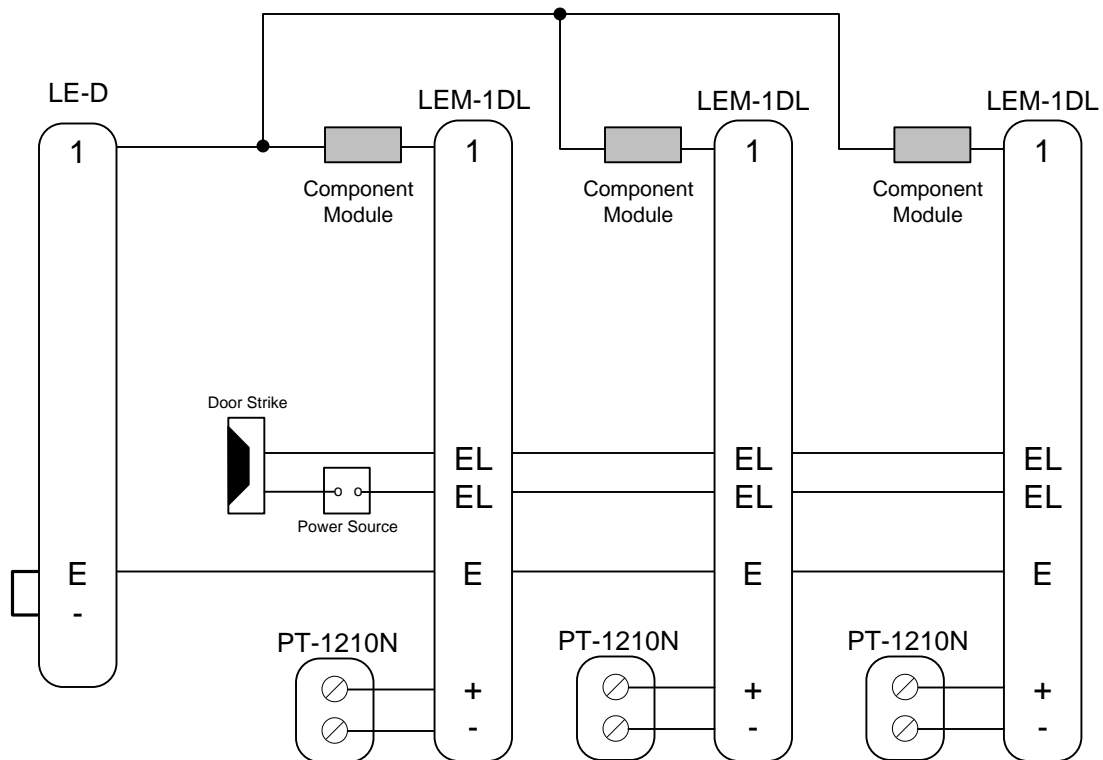

## NOTES:

1. Install the bare wire end of the DAK-2S component module to "1" terminal of the LEM-1DL masters.
2. Only one master can be used at a time.
3. Each master **MUST** have its own power supply. Otherwise, ground loop feedback will occur when either master station is on.