


## MODIFICATION DIAGRAM

### THREE LEM-3 MASTER STATIONS WITH ONE SUB STATION

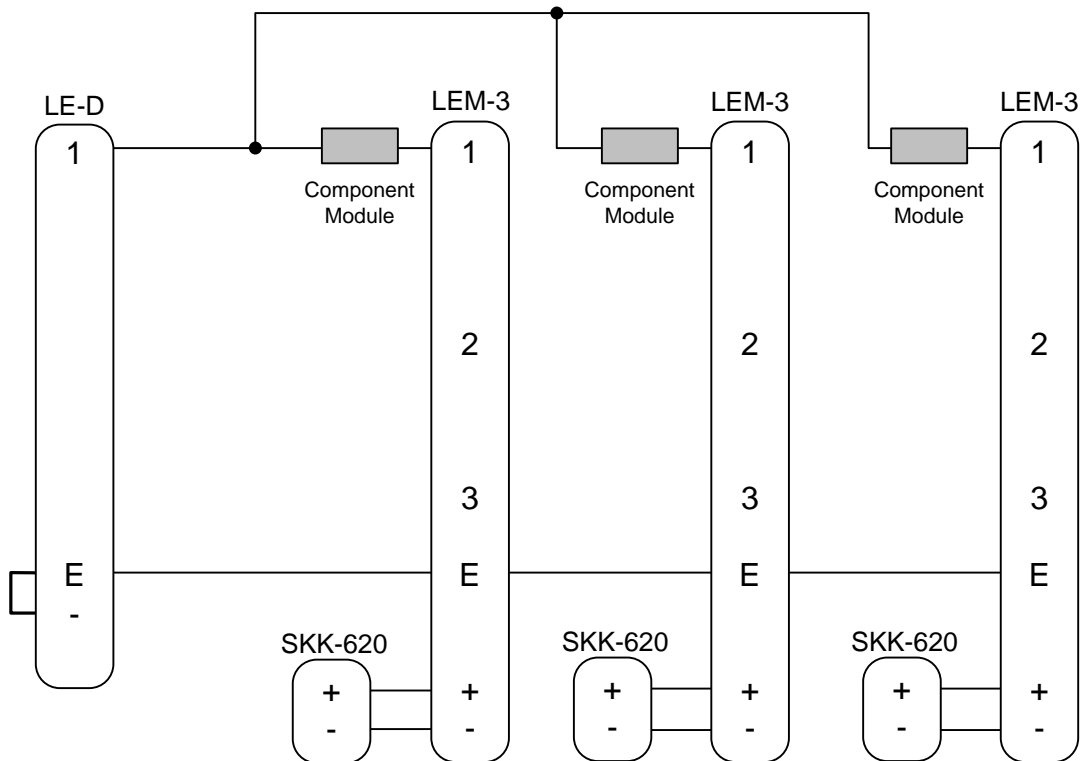

#### NOTES:

1. Install the bare wire end of the DAK-2S component module to # terminals of the LEM-3 masters.
2. Only one master can be used at a time.
3. Each master **MUST** have its own power supply. Otherwise, ground loop feedback will occur when any master station is on.