


WIRING DIAGRAM

Five LEF-5 with 3 LE-D and Door Release

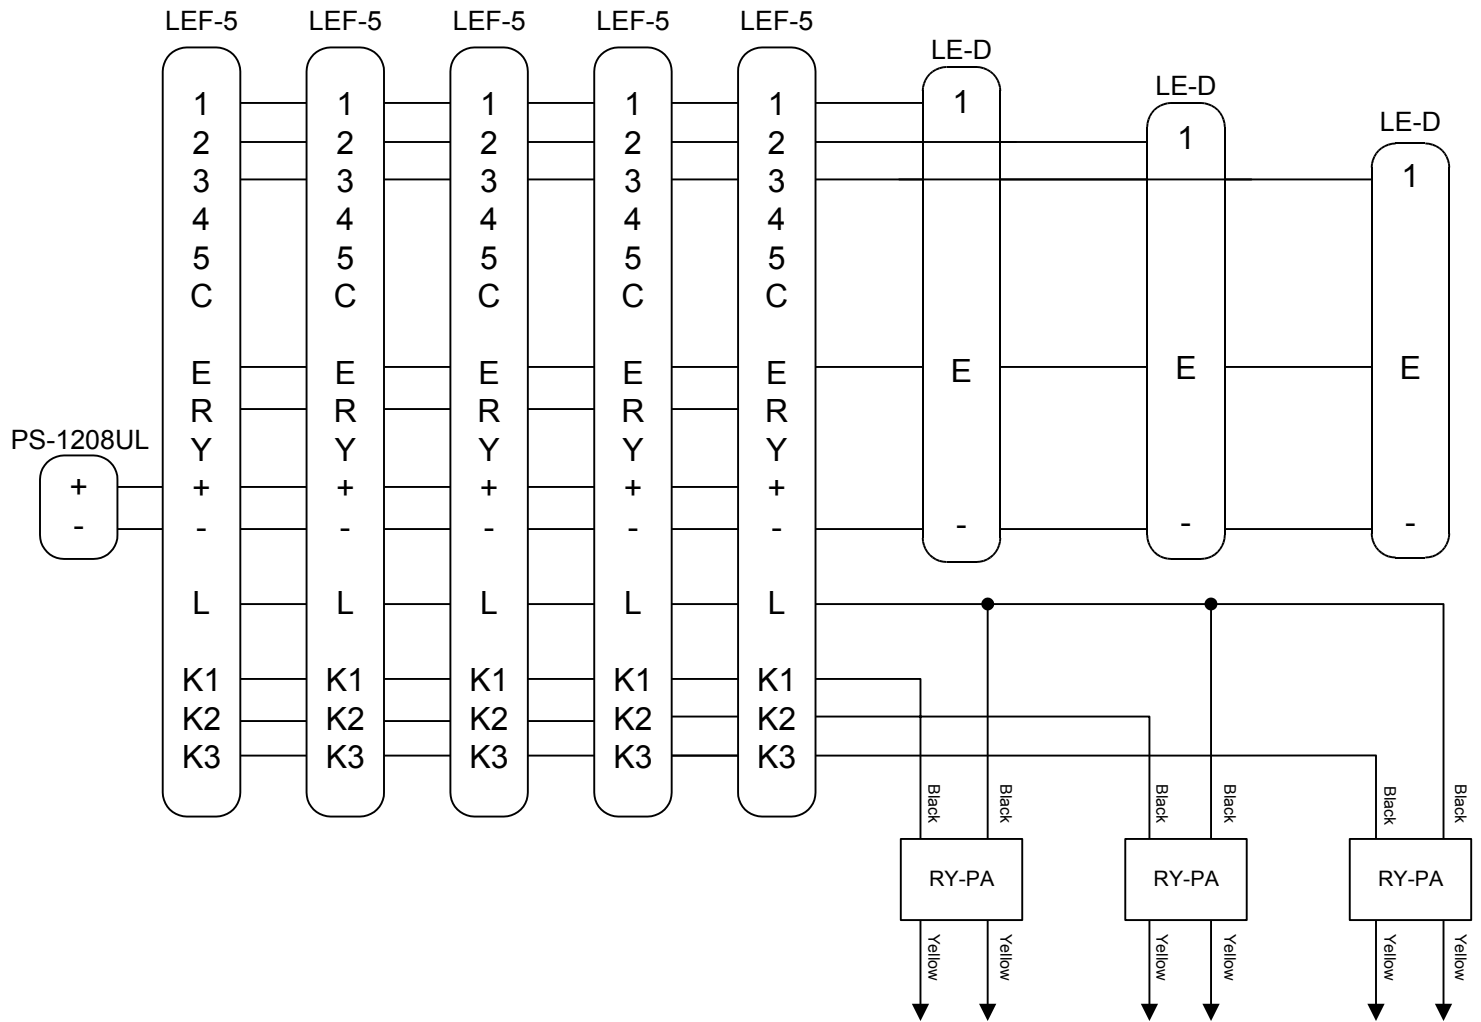

To Strikes and Power

Minimum wire count between masters is 11 conductors shielded.
If noise problems occur, tie shield of wire to an earth ground.